


## WATER SERVICE INSTALLATION

The owner's service line must be a minimum of 3/4" diameter. It must be buried at a minimum of 4 1/2'. Approved pipe materials are:

**TYPE "K" COPPER** - If fittings are used underground, only compression fittings are approved.

**HIGH DENSITY POLYETHYLENE PLASTIC PIPE** - Rated for 160 PSI or greater, CTS (Copper Tube Size). If fittings are used underground, only compression fittings with stainless steel stiffeners are approved.

**CROSS-LINKED POLYETHYLENE (PEX)** - Rated for 160 PSI or greater, CTS (Copper Tube Size). If fittings are used underground, only mechanical or compression fittings with insert stiffeners are approved.

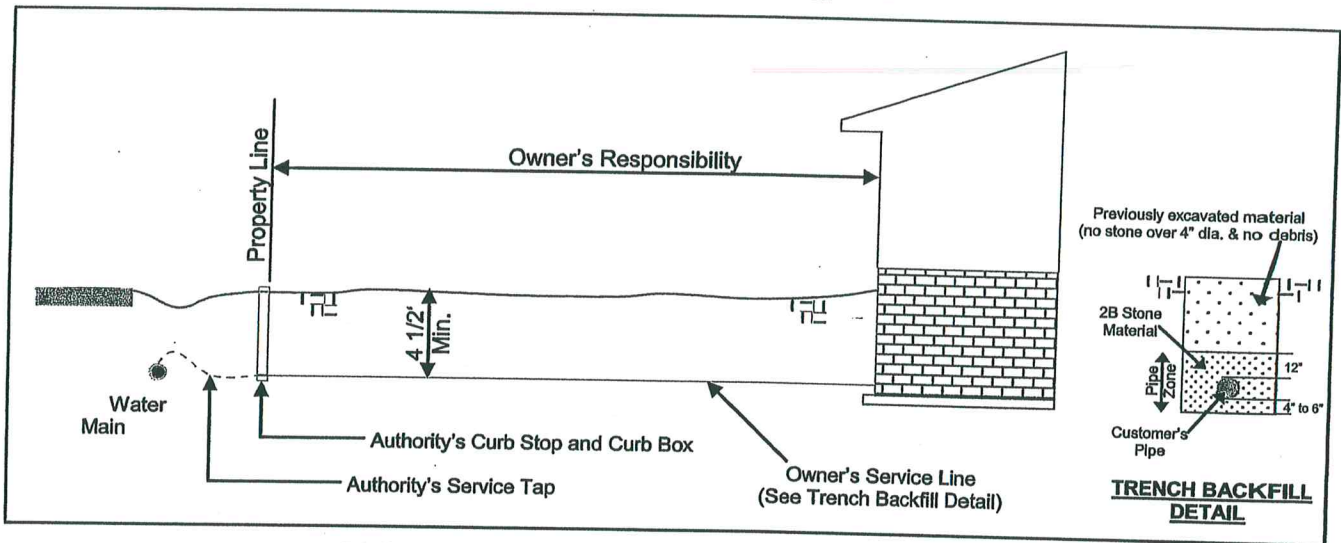

## REQUIRED PLUMBING FOR METER INSTALLATION

Coming into the basement from the outside, extend the pipe a minimum of 5" from the wall. Bring the pipe to a horizontal position a minimum of 2' and a maximum of 4' from the floor level, and install as shown below in this order:

- (A) 3/4" shut off valve
- (B) 3/4" Pressure Reducing Valve
- (C) 3/4" x 3/4" F.I.P. adaptor
- (D) 12 1/2" spacer (includes (2) 5/8" x 3/4" meter couplings and 5/8" meter spacer)
- (C) 3/4" x 3/4" F.I.P. adaptor
- (E) 3/4" Check Valve

Everything in this diagram is the property and maintenance responsibility of the customer with the exception of (D) The Meter Spacer.

